


ATTACHMENT A
 Schematic Flow Diagram, Discharge Lines, Flow Meter Location - UES Pretreatment Plant - Ship Bilge Water Treatment Plant 1650 Hemlock ST Tampa FL - Existing Permit 0312672-001-DCW / Service Request 07-03-12A

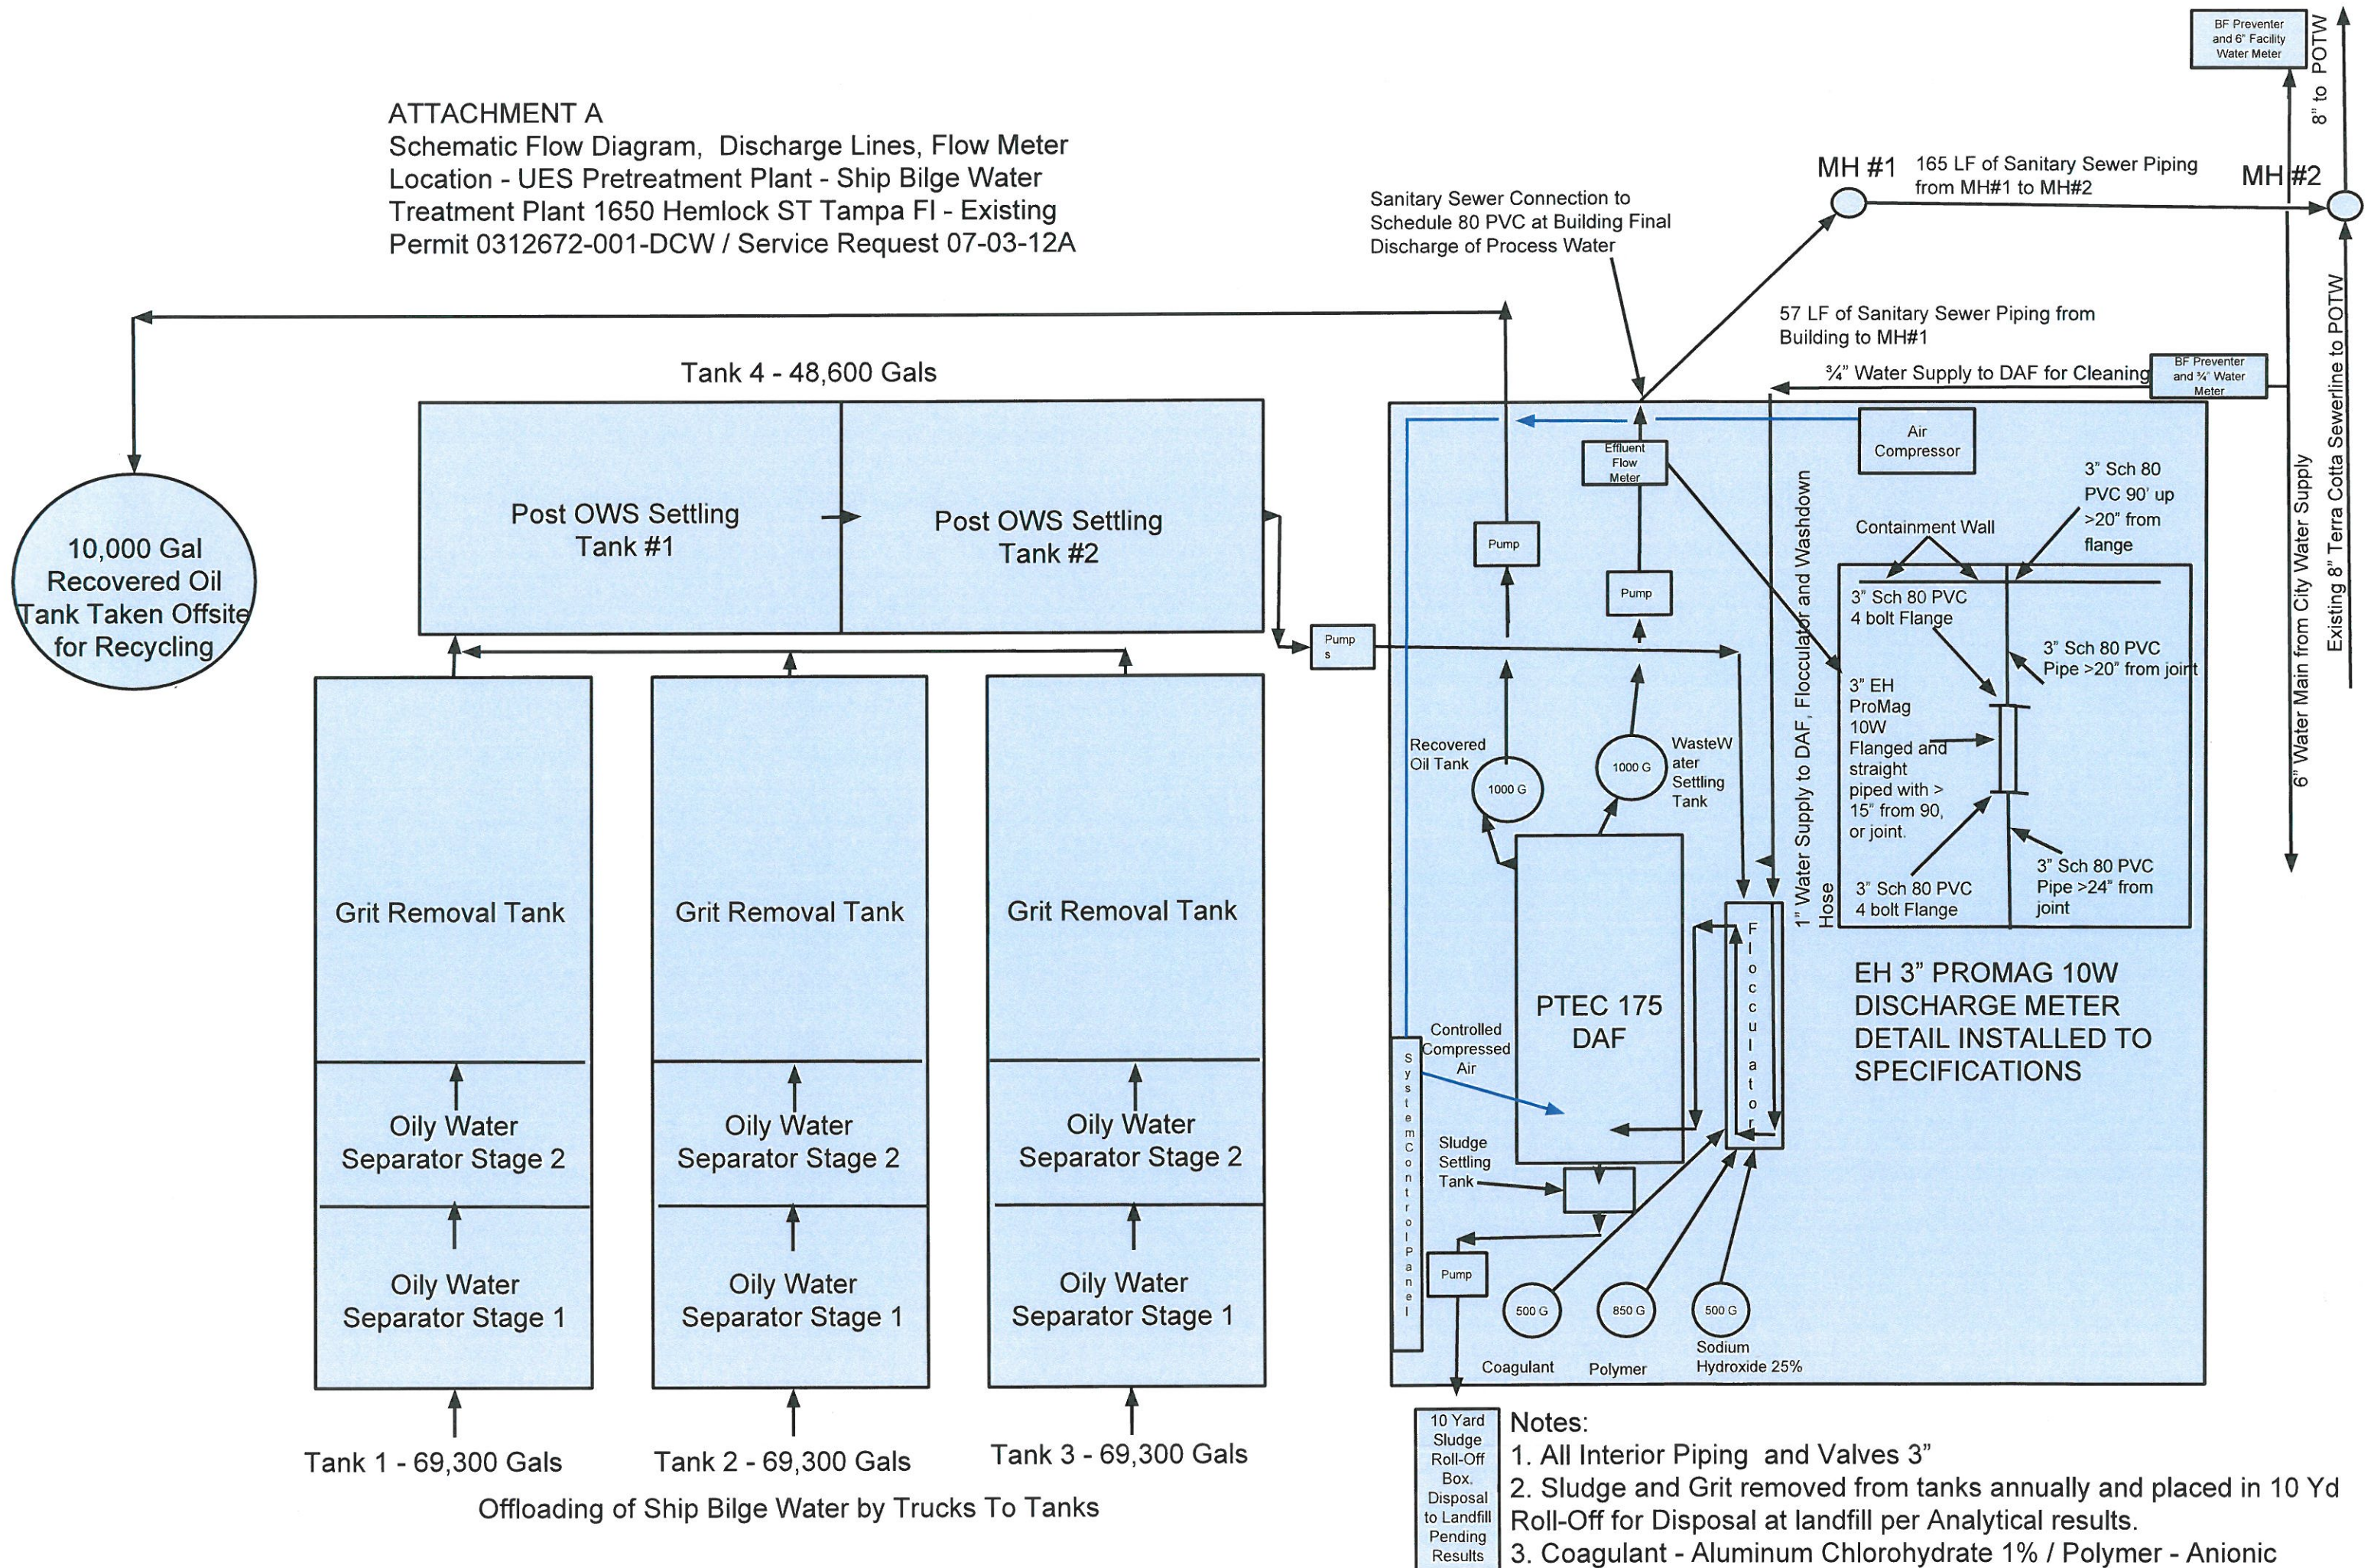

10 Yard Sludge Roll-Off Box. Disposal to Landfill Pending Results

- Notes:
1. All Interior Piping and Valves 3"
 2. Sludge and Grit removed from tanks annually and placed in 10 Yd Roll-Off for Disposal at landfill per Analytical results.
 3. Coagulant - Aluminum Chlorohydrate 1% / Polymer - Anionic